

Air Monitoring Summary Tables

The table below summarizes monitoring data collected using EPA's Viper wireless remote monitoring system.

Project Name: H₂S in South and North Carolina

From: 6/5/21
12:01 AM

To: 6/5/21
11:59 PM



William-Lytle Place							
Instrument	Analyte	ATSDR MRL Exceedance?	Number of Readings	Number of Detections	Concentration Range	Period Average	ATSDR MRL
SPM Flex 1	H ₂ S	No	54234	7506	0 - 10 ppb	0.39 ppb	70 ppb

River Chase							
Instrument	Analyte	ATSDR MRL Exceedance?	Number of Readings	Number of Detections	Concentration Range	Period Average	ATSDR MRL
SPM Flex 2	H ₂ S	No	53731	10952	0 - 9 ppb	0.62 ppb	70 ppb

Millstone Creek							
Instrument	Analyte	ATSDR MRL Exceedance?	Number of Readings	Number of Detections	Concentration Range	Period Average	ATSDR MRL
SPM Flex 3	H ₂ S	No	52052	1870	0 - 3 ppb	0.07 ppb	70 ppb

Sun City							
Instrument	Analyte	ATSDR MRL Exceedance?	Number of Readings	Number of Detections	Concentration Range	Period Average	ATSDR MRL
SPM Flex 4	H ₂ S	No	53878	3810	0 - 6 ppb	0.15 ppb	70 ppb

Bridgemill							
Instrument	Analyte	ATSDR MRL Exceedance?	Number of Readings	Number of Detections	Concentration Range	Period Average	ATSDR MRL
SPM Flex 5	H ₂ S	No	52322	1122	0 - 2 ppb	0.03 ppb	70 ppb

Tom Steven Rd							
Instrument	Analyte	ATSDR MRL Exceedance?	Number of Readings	Number of Detections	Concentration Range	Period Average	ATSDR MRL
SPM Flex 6	H ₂ S	No	51794	16724	0 - 22 ppb	1.71 ppb	70 ppb

Sturgis Rd							
Instrument	Analyte	ATSDR MRL Exceedance?	Number of Readings	Number of Detections	Concentration Range	Period Average	ATSDR MRL
SPM Flex 7	H ₂ S	No	53042	2878	0 - 2 ppb	0.07 ppb	70 ppb

Marvin							
Instrument	Analyte	ATSDR MRL Exceedance?	Number of Readings	Number of Detections	Concentration Range	Period Average	ATSDR MRL
SPM Flex 8	H ₂ S	No	53626	1950	0 - 3 ppb	0.06 ppb	70 ppb


Treetop							
Instrument	Analyte	ATSDR MRL Exceedance?	Number of Readings	Number of Detections	Concentration Range	Period Average	ATSDR MRL
SPM Flex 9	H ₂ S	No	54458	1084	0 - 1 ppb	0.02 ppb	70 ppb

Liberty Hill							
Instrument	Analyte	ATSDR MRL Exceedance?	Number of Readings	Number of Detections	Concentration Range	Period Average	ATSDR MRL
SPM Flex 10	H ₂ S	No	52824	2154	0 - 4 ppb	0.08 ppb	70 ppb

Notes:

Hydrogen sulfide concentrations presented in this data summary table are converted from parts per million, the instrument readout units, to parts per billion.

ATSDR MRL Agency for Toxic Substances and Disease Registry Minimal Risk Level - Acute Exposure (<14 days)
 H₂S Hydrogen Sulfide
 hr Hour
 ppb Parts per billion
 MRL Exceedance Defines if the 24-hr TWA exceeded the MRL at any time during the period of this report
 SPM Single Point Monitor
 TWA Time Weighted Average

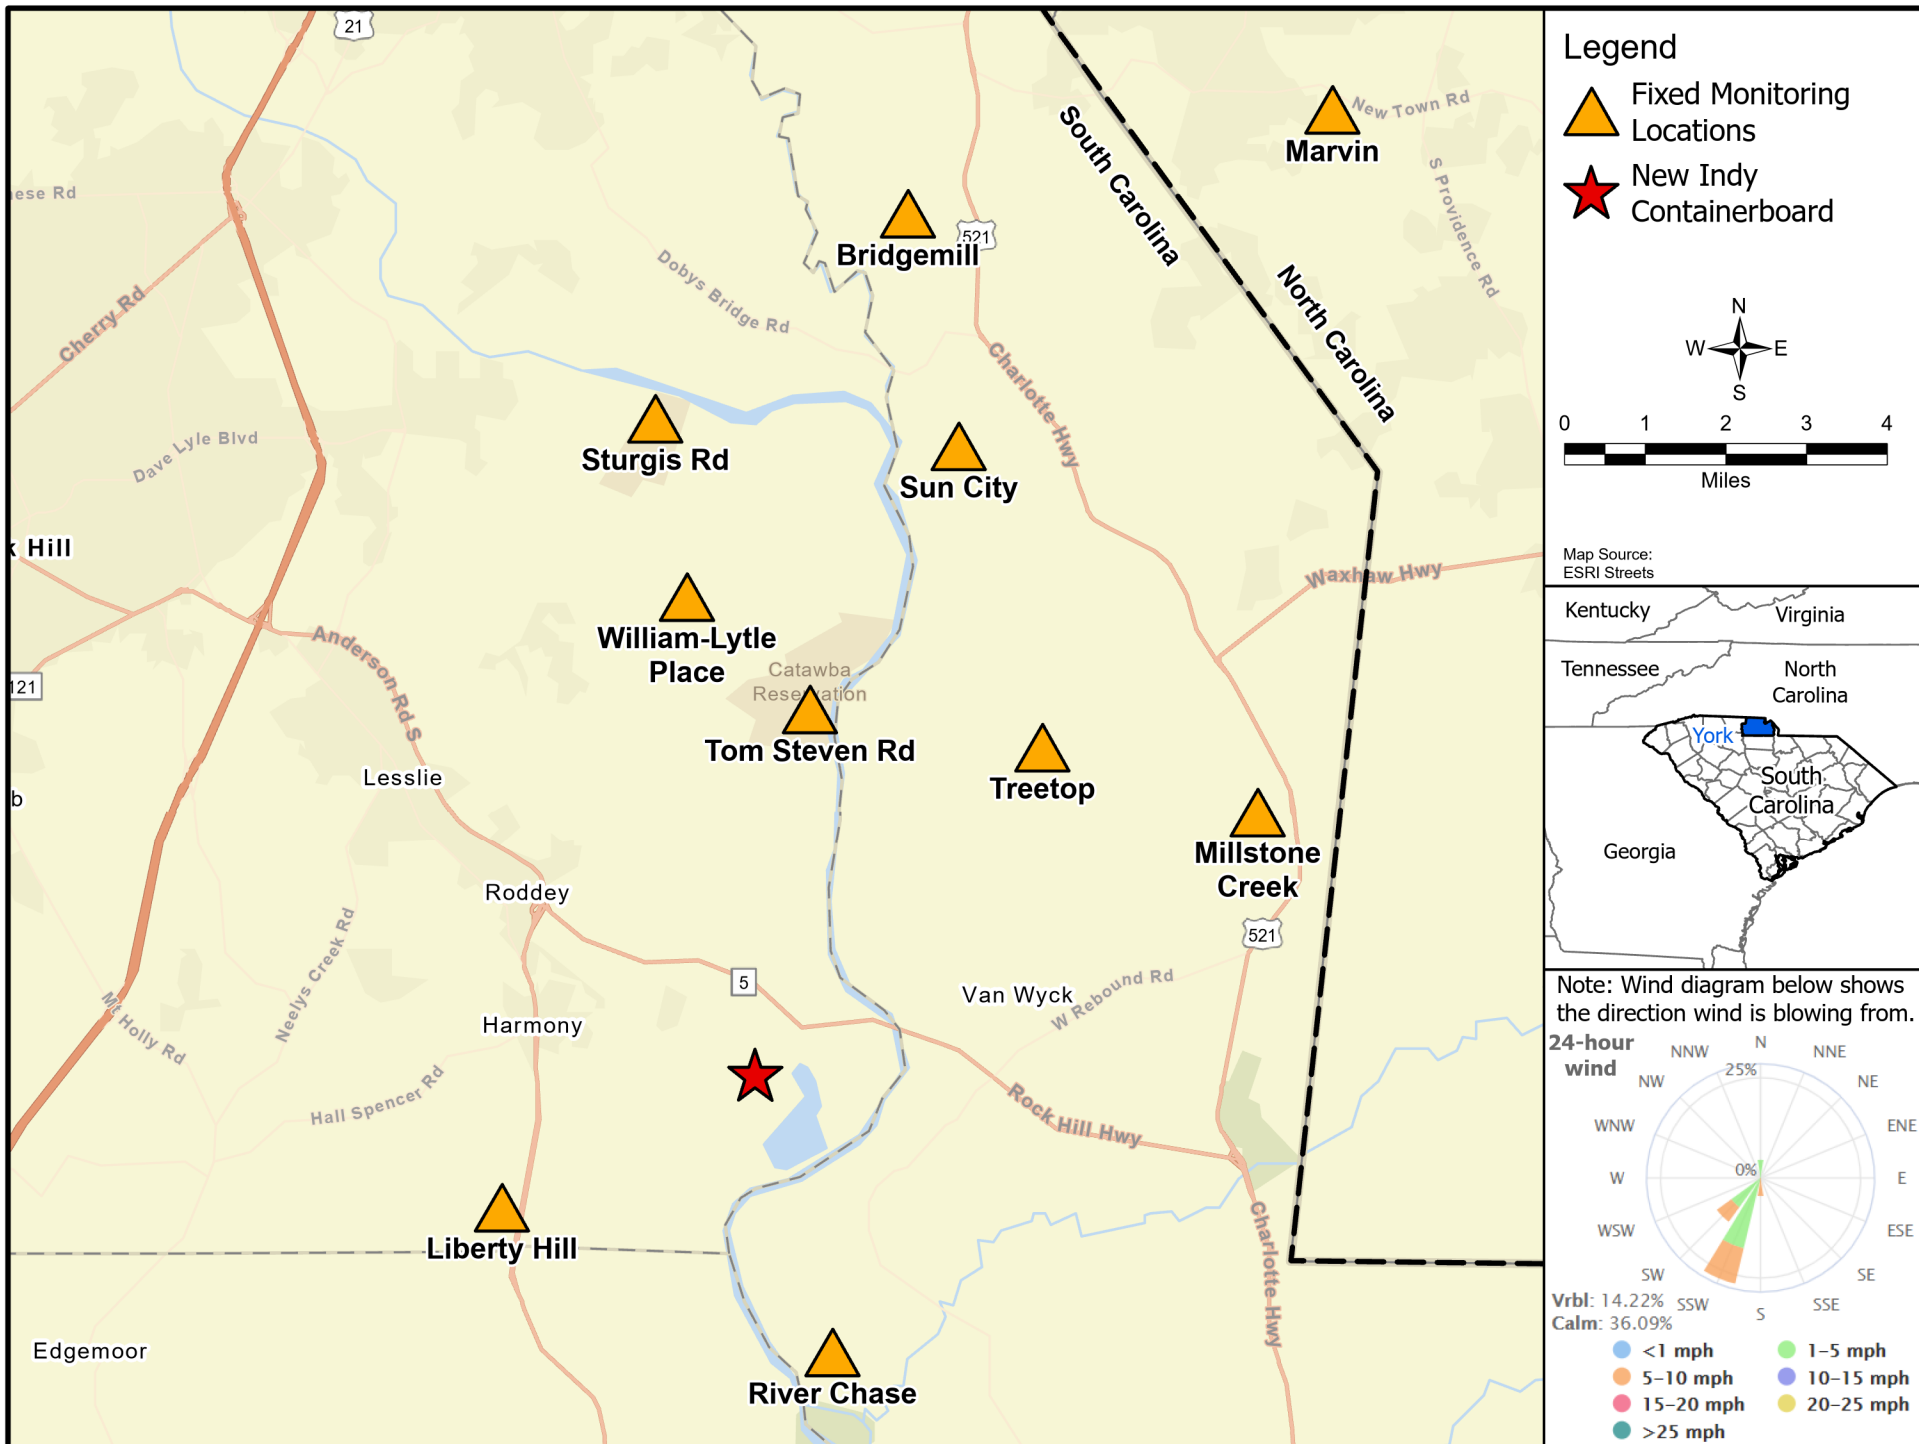


H₂S in South and North Carolina

Hydrogen Sulfide 15-min and 24-hr Time Weighted Graphs

Only locations where hydrogen sulfide was detected during the current reporting period are graphed below.


The prevailing wind directions for this reporting period were out of the south-southwest with a smaller percentage out of the southwest. See wind rose diagram on location figure for full wind data during this reporting period.

All locations detected hydrogen sulfide above 1 part per billion for this reporting period.

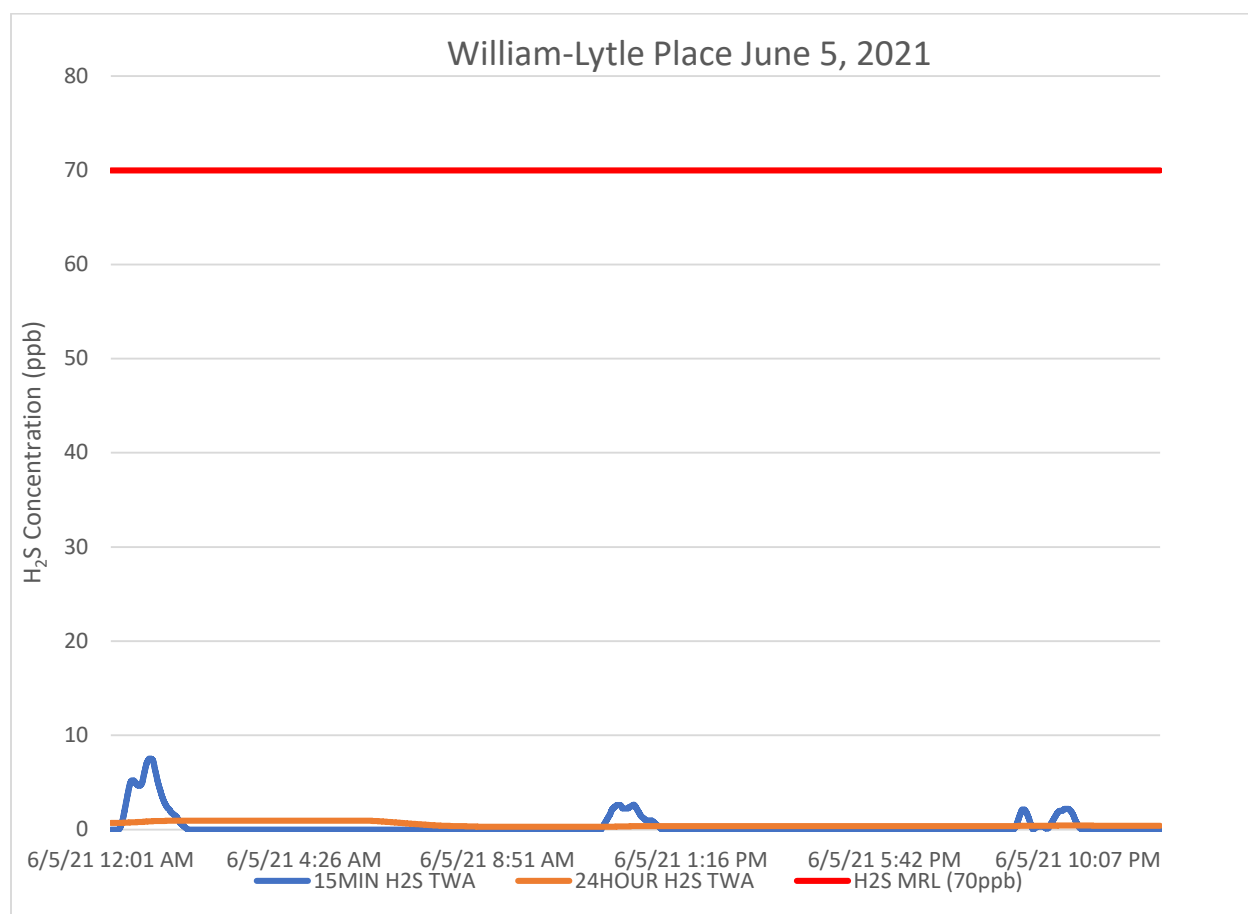


Notes:

H₂S – Hydrogen Sulfide
MIN – Minute
MRL – Minimal Risk Level
ppb – Parts per billion
TWA – Time weighted average

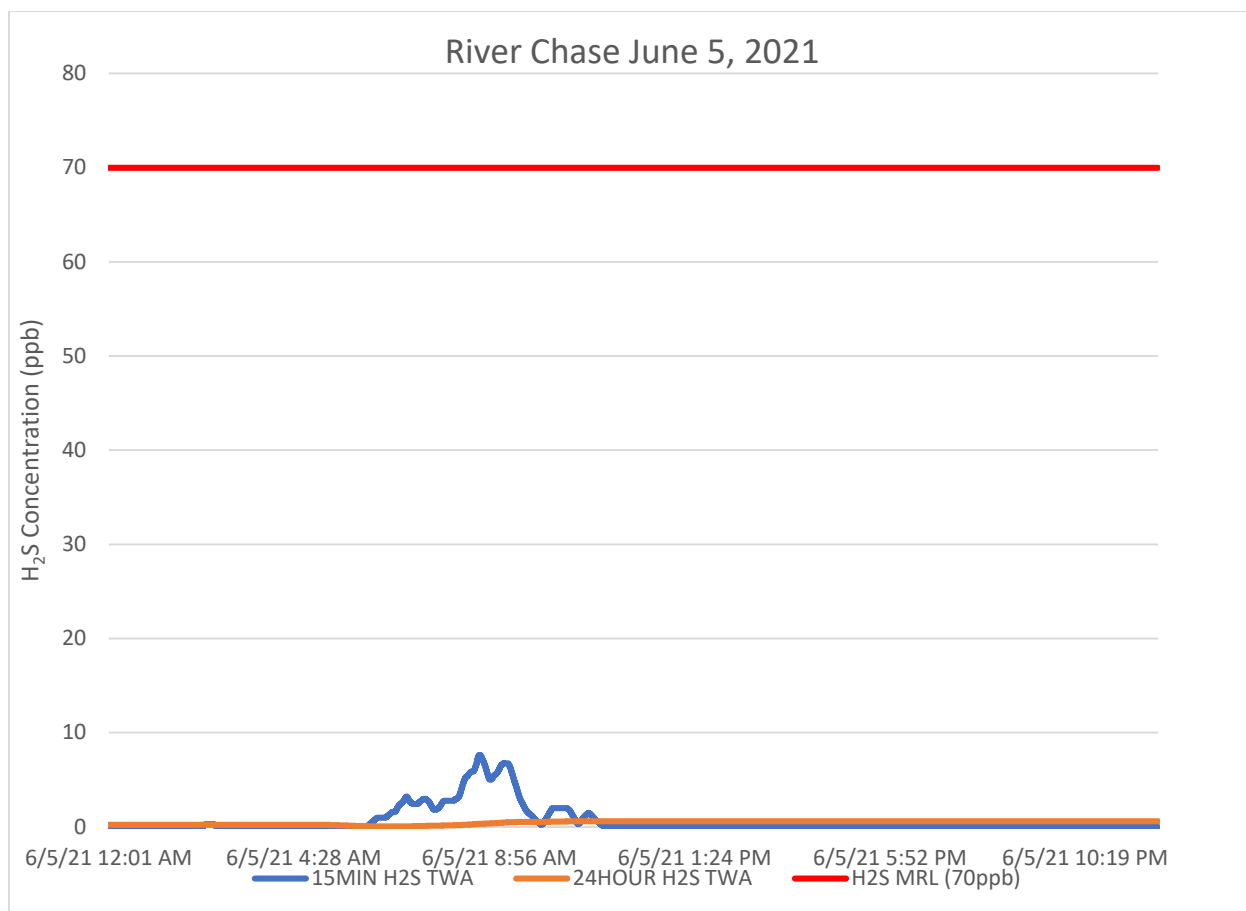


Notes:

H₂S – Hydrogen Sulfide
MIN – Minute
MRL – Minimal Risk Level
ppb – Parts per billion
TWA – Time weighted average

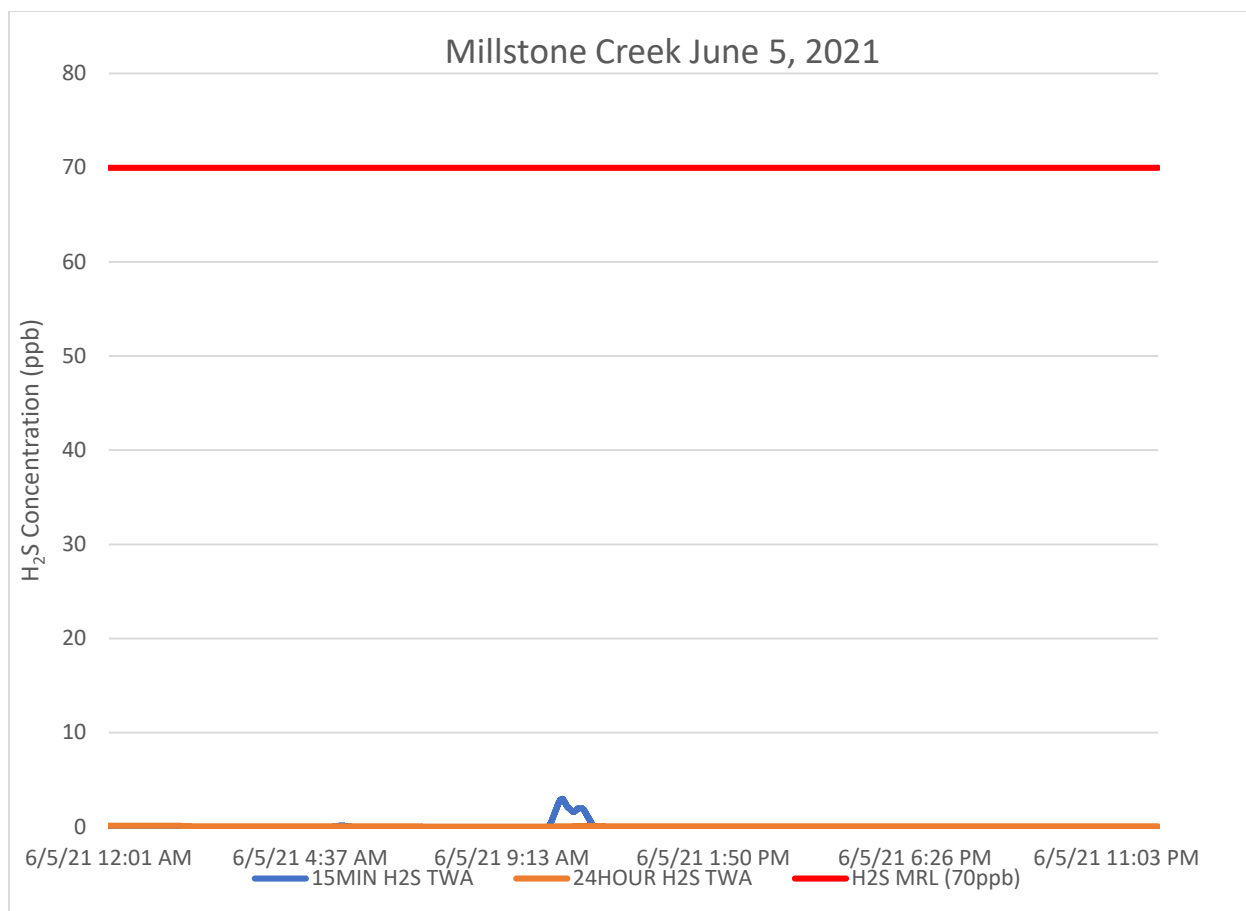


Notes:

H₂S – Hydrogen Sulfide
MIN – Minute
MRL – Minimal Risk Level
ppb – Parts per billion
TWA – Time weighted average

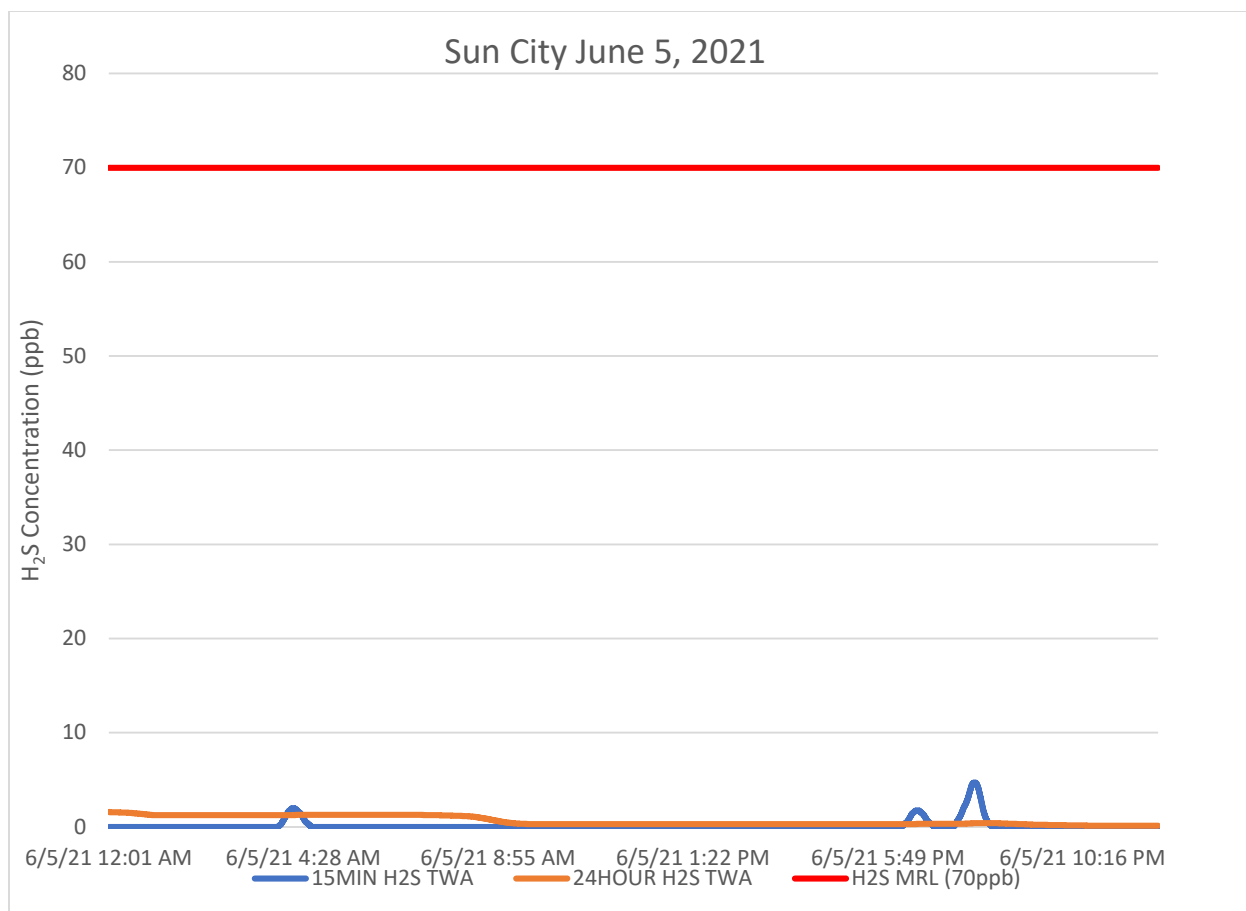


Notes:

H₂S – Hydrogen Sulfide
MIN – Minute
MRL – Minimal Risk Level
ppb – Parts per billion
TWA – Time weighted average

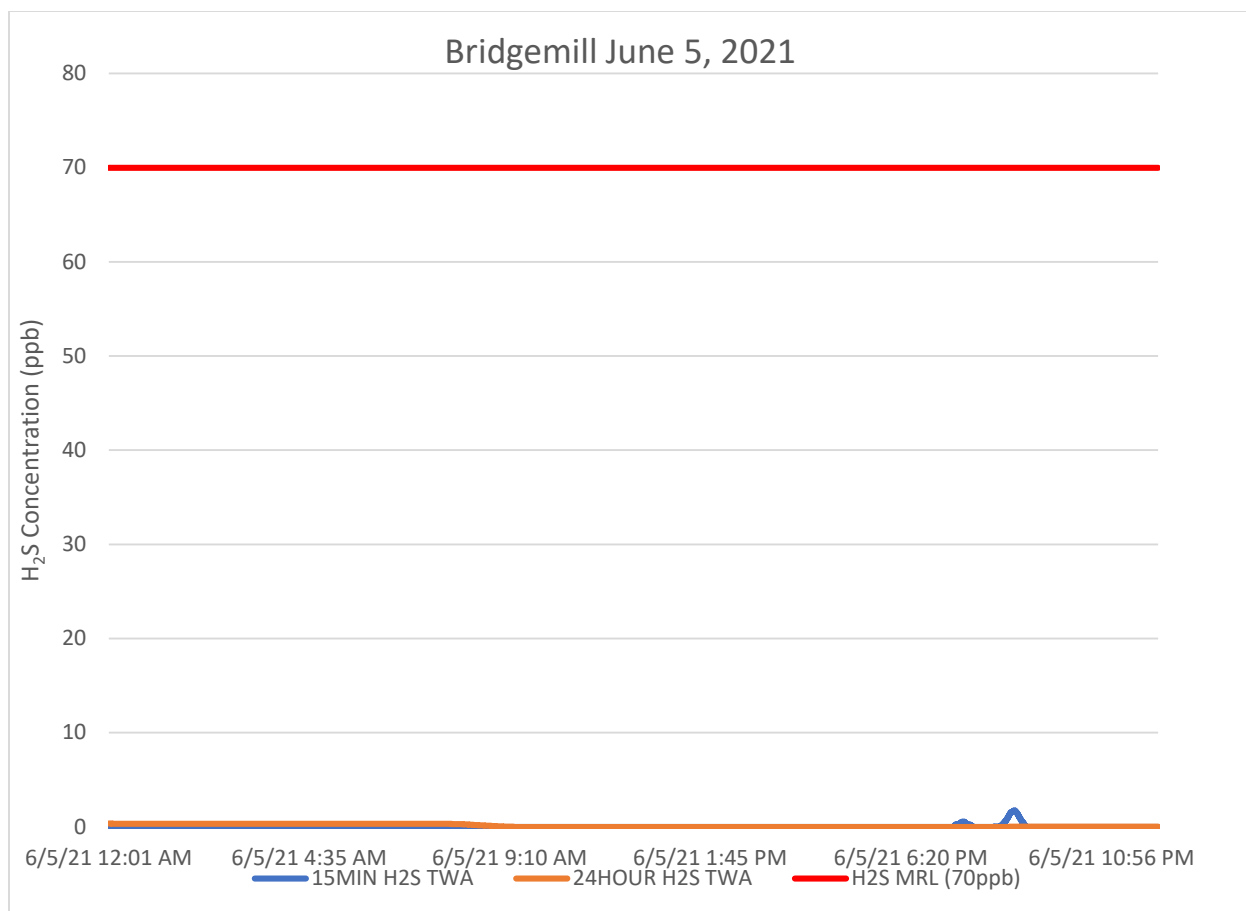


Notes:

H₂S – Hydrogen Sulfide
MIN – Minute
MRL – Minimal Risk Level
ppb – Parts per billion
TWA – Time weighted average

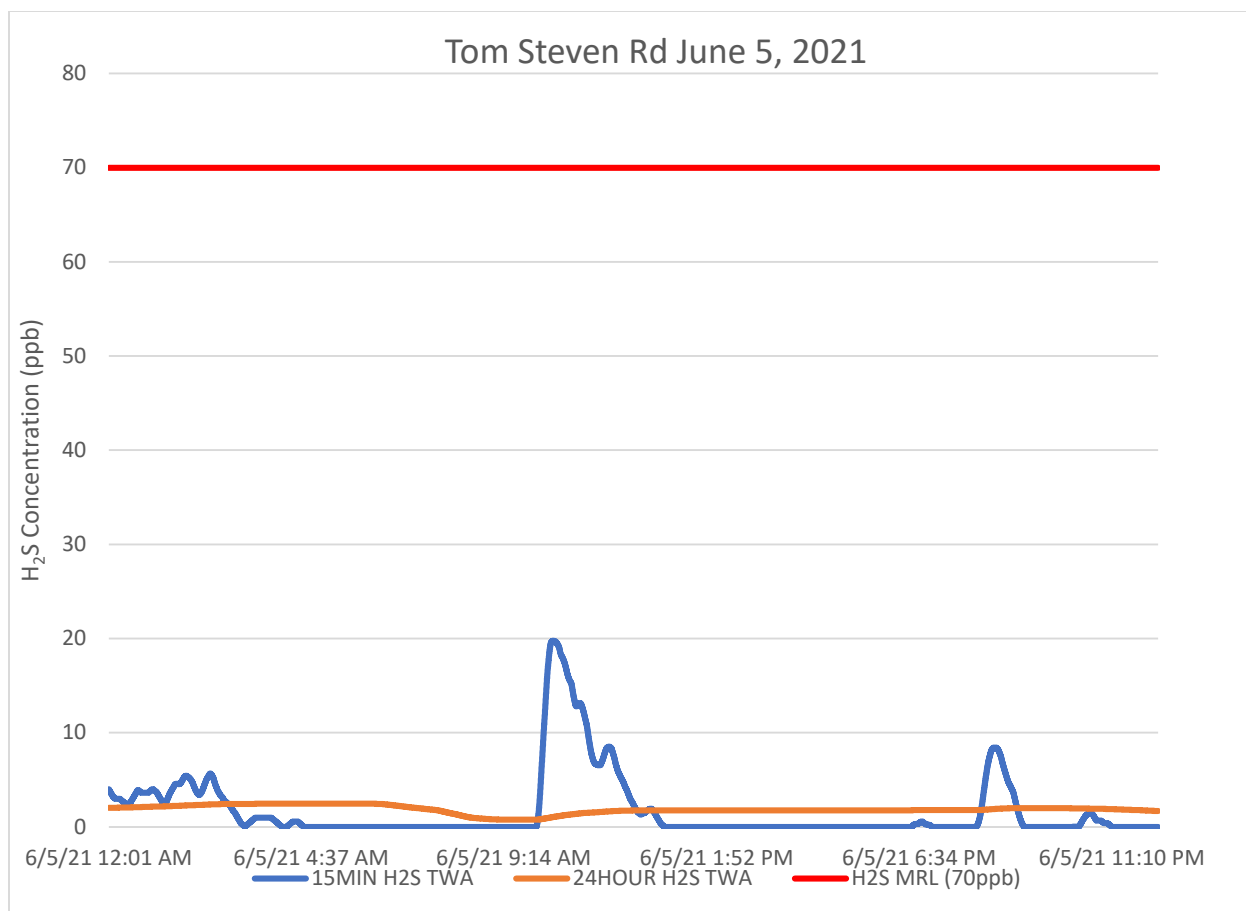


Notes:

H₂S – Hydrogen Sulfide
MIN – Minute
MRL – Minimal Risk Level
ppb – Parts per billion
TWA – Time weighted average

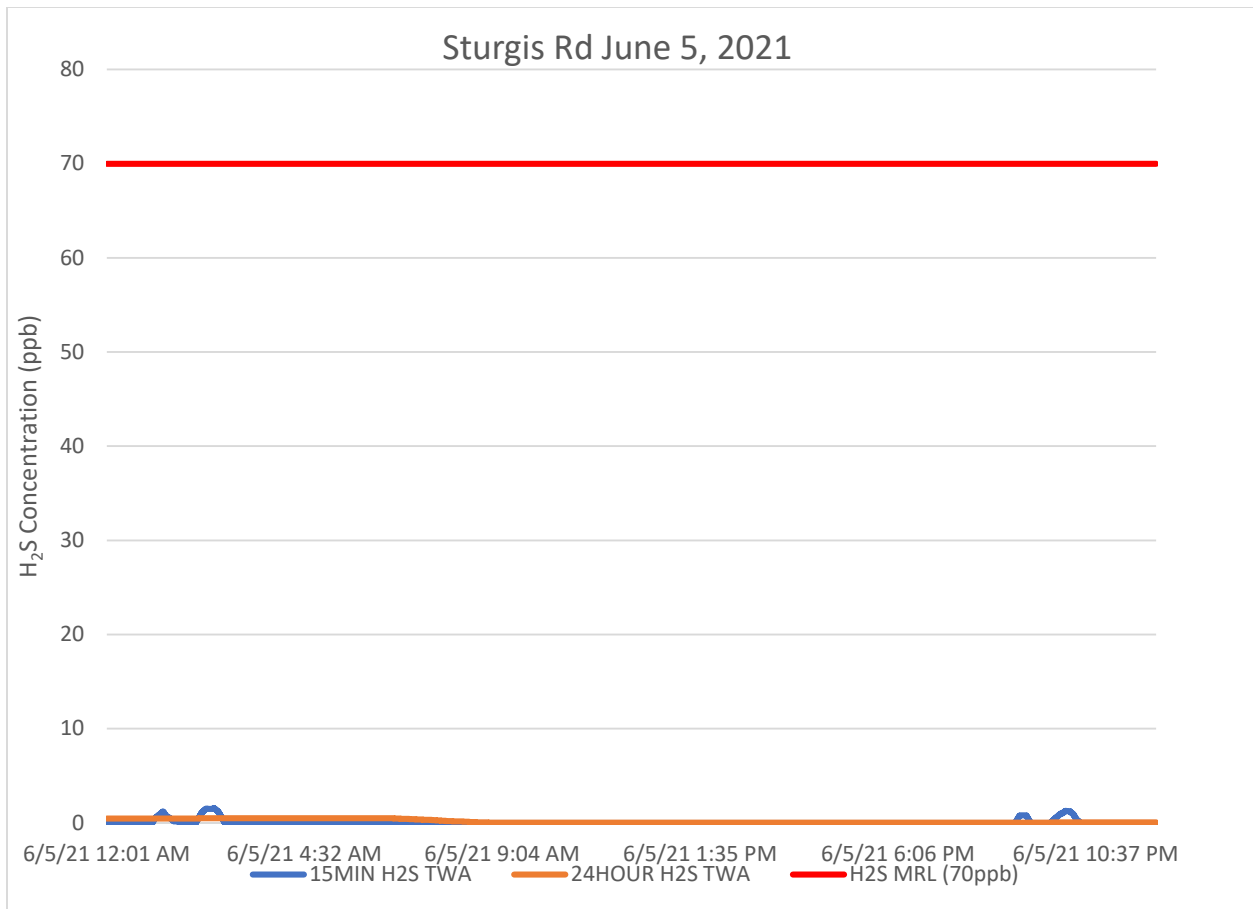


Notes:

H₂S – Hydrogen Sulfide
MIN – Minute
MRL – Minimal Risk Level
ppb – Parts per billion
TWA – Time weighted average

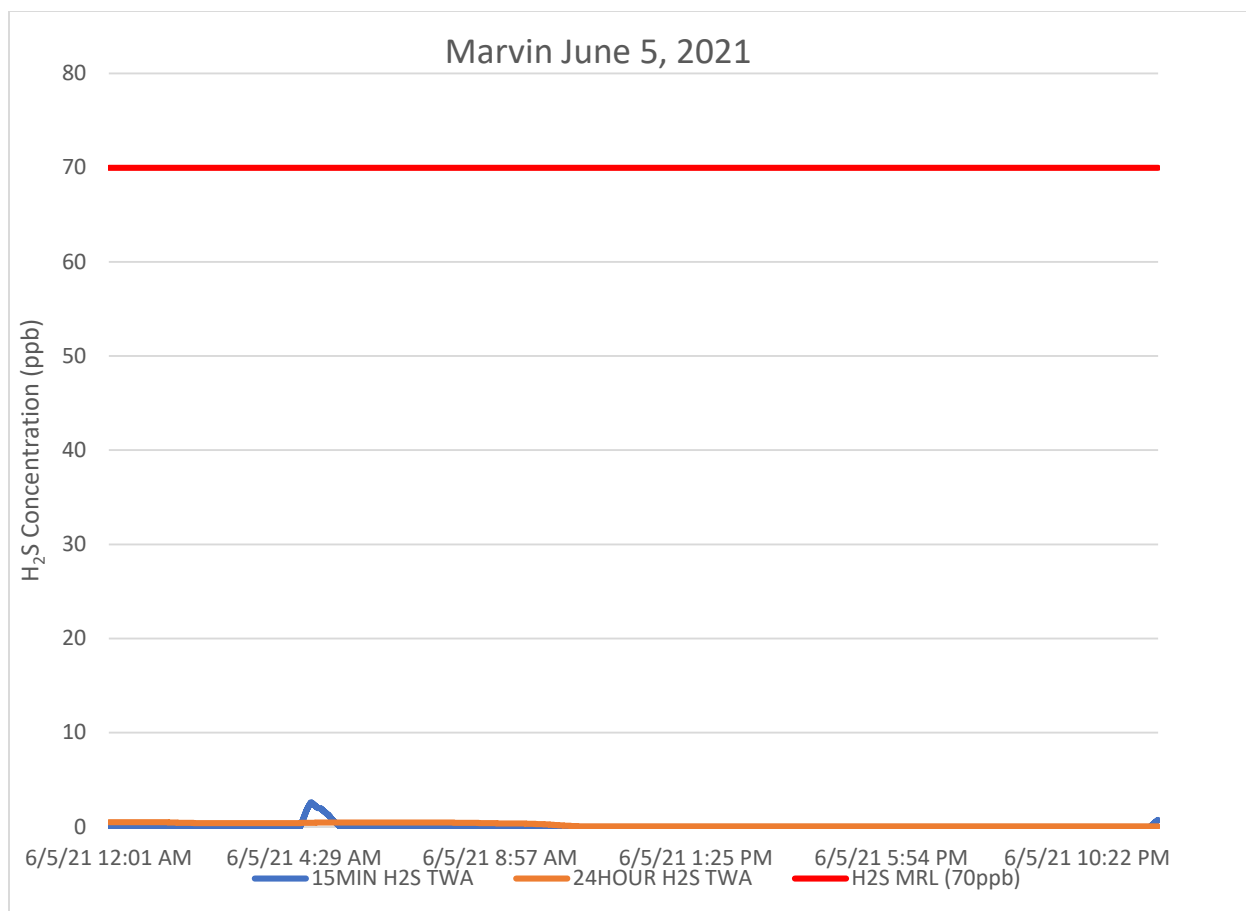


Notes:

H₂S – Hydrogen Sulfide
MIN – Minute
MRL – Minimal Risk Level
ppb – Parts per billion
TWA – Time weighted average

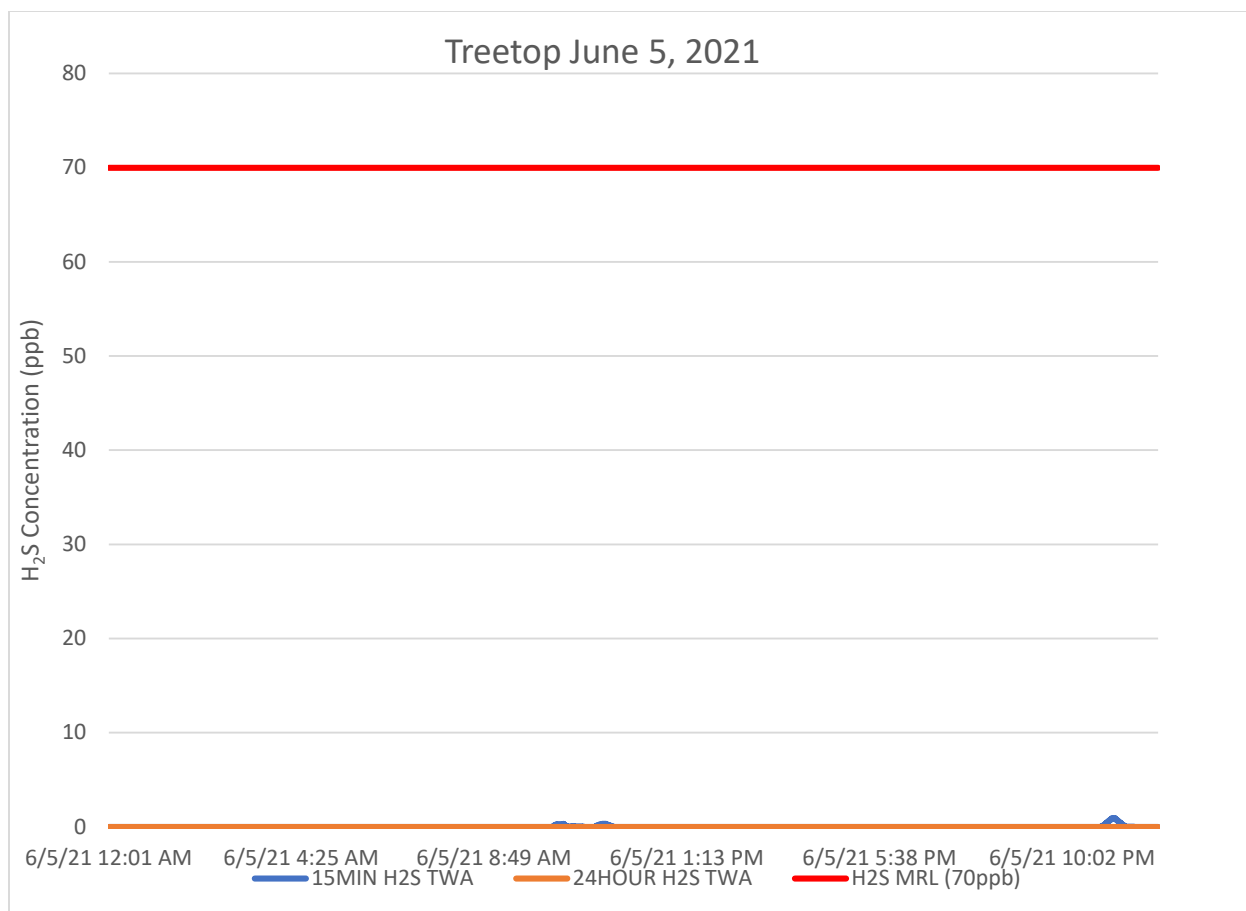

Notes:

H₂S – Hydrogen Sulfide
MIN – Minute
MRL – Minimal Risk Level
ppb – Parts per billion
TWA – Time weighted average

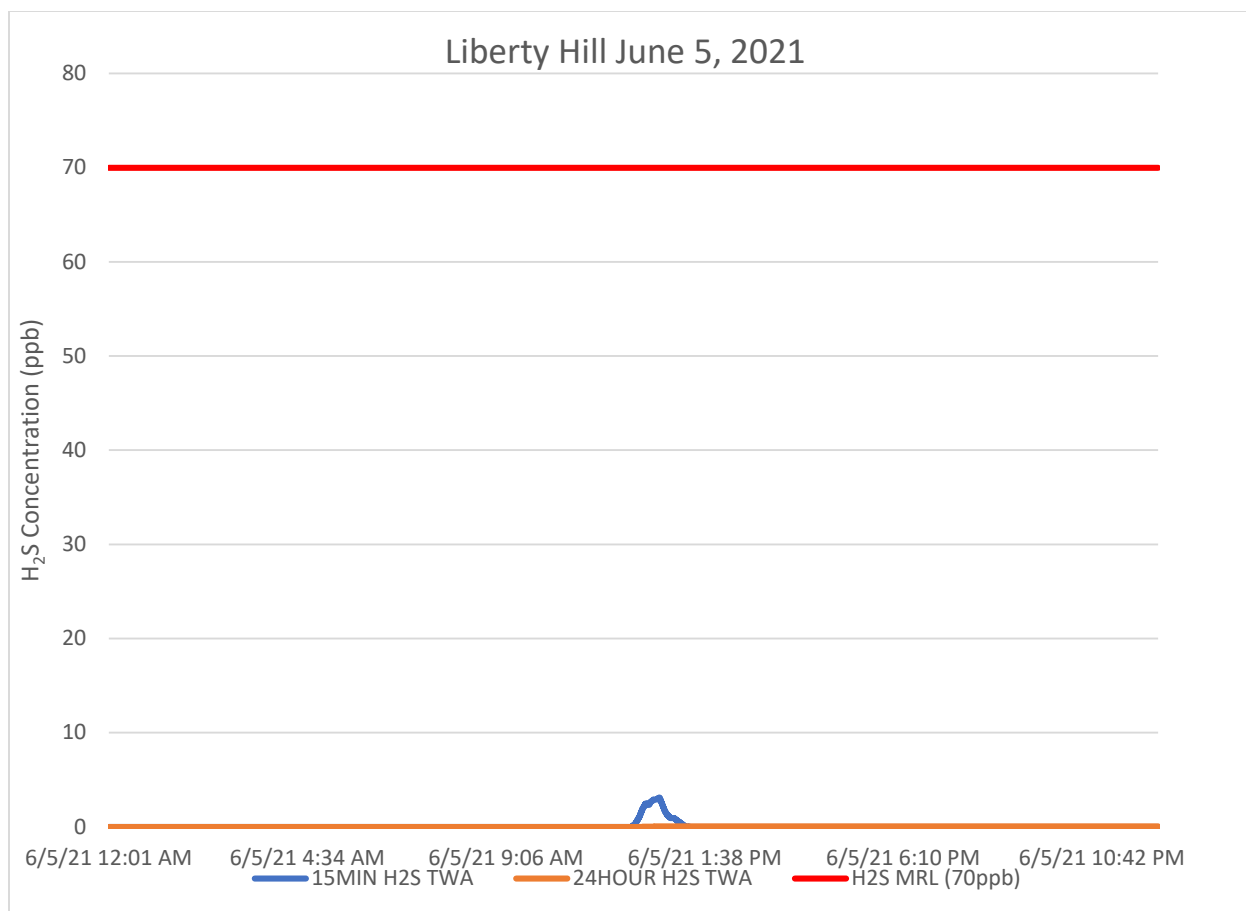

Notes:

H₂S – Hydrogen Sulfide
MIN – Minute
MRL – Minimal Risk Level
ppb – Parts per billion
TWA – Time weighted average