

Air Monitoring Summary Tables

The table below summarizes monitoring data collected using a portable wireless remote monitoring system.
All times in Eastern Standard Time (EST).

From: 10/10/24 12:00 am To: 10/10/24 11:59 pm

Offsite Monitors

Instrument	Analyte	ATSDR MRL 14-day Avg Reached?	Concentration Range Detected ^a	24-hr Average ^a	7-day Average	ATSDR 14-day MRL
Catawba Headstart						
Acrulog PPB	H ₂ S	No	0 – 0 ppb	0.00 ppb ^d	0.01 ppb	70 ppb
Treetops						
Acrulog PPB	H ₂ S	No	0 – 0 ppb	0.00 ppb ^e	0.01 ppb	70 ppb
Liberty Hill						
Acrulog PPB	H ₂ S	No	0 – 2 ppb	0.06 ppb ^f	0.57 ppb	70 ppb
Riverchase Estates						
Acrulog PPB	H ₂ S	No	0 – 0 ppb	0.00 ppb ^g	0.01 ppb	70 ppb
Millstone Creek						
Acrulog PPB	H ₂ S	No	0 – 0 ppb	0.00 ppb ^h	0.00 ppb	70 ppb

^d The 24-hour H₂S average at Catawba Headstart is not represented by the full 24-hour sampling period; a total of 16 30-minute averages are missing due to a span-precision-zero check and the removal of the station from sampling at this location.

^e The 24-hour H₂S average at Treetops is not represented by the full 24-hour sampling period; a total of 18 30-minute averages are missing due to a span-precision-zero check and the removal of the station from sampling at this location.

^f The 24-hour H₂S average at Liberty Hill is not represented by the full 24-hour sampling period; a total of 17 30-minute averages are missing due to a span-precision-zero check and the removal of the station from sampling at this location.

^g The 24-hour H₂S average at Riverchase Estates is not represented by the full 24-hour sampling period; a total of 23 30-minute averages are missing due to a span-precision-zero check and the removal of the station from sampling at this location.

^h The 24-hour H₂S average at Millstone Creek is not represented by the full 24-hour sampling period; a total of 19 30-minute averages are missing due to a span-precision-zero check and the removal of the station from sampling at this location.

Onsite Fenceline Monitors

Instrument	Analyte	30-min AEGL Reached?	Concentration Range Detected ^a	24-hr Average ^a	7-day Average	30-min AEGL
Station 1						
TAPI Analyzer	H ₂ S	No	0 – 37 ppb	6.71 ppb ^b	7.70 ppb	600 ppb
Station 2						
TAPI Analyzer	H ₂ S	No	0 – 0 ppb	0.20 ppb ^c	0.22 ppb	600 ppb
Station 3						
TAPI Analyzer	H ₂ S	No	0 – 0 ppb	0.20 ppb	0.24 ppb	600 ppb

^a Based on 30-minute averages.




^b The 24-hour H₂S average at Station 1 is represented by the 30-minute averages from the primary unit from the start of the sampling period up until 11:30 EST, and from the back-up unit from 12:00 EST until the end of the sampling period.

^c The 24-hour H₂S average at Station 2 from the start of the sampling period to the end of the sampling period is represented by the backup unit data.

Notes:

ATSDR MRL	Agency for Toxic Substances and Disease Registry Minimal Risk Level (MRL)
AEGL	EPA Acute Exposure Guidelines Levels
H ₂ S	Hydrogen Sulfide
TAPI	Teledyne API H ₂ S Analyzer
hr	Hour
min	Minute
ppb	Parts per billion
MRL Limit	Limit defined as a 14-day average value

Station 1 Wind Rose – Shows the direction the wind is coming from, the monitoring station being at the center of the rose.

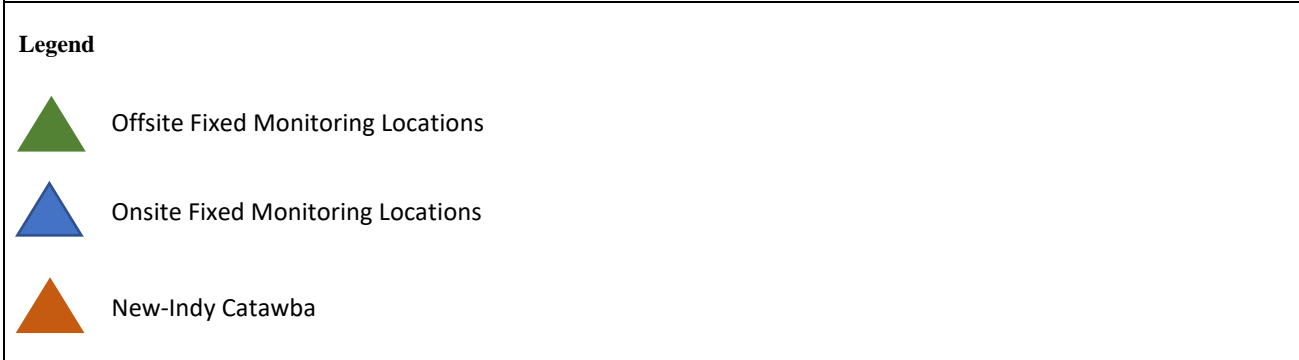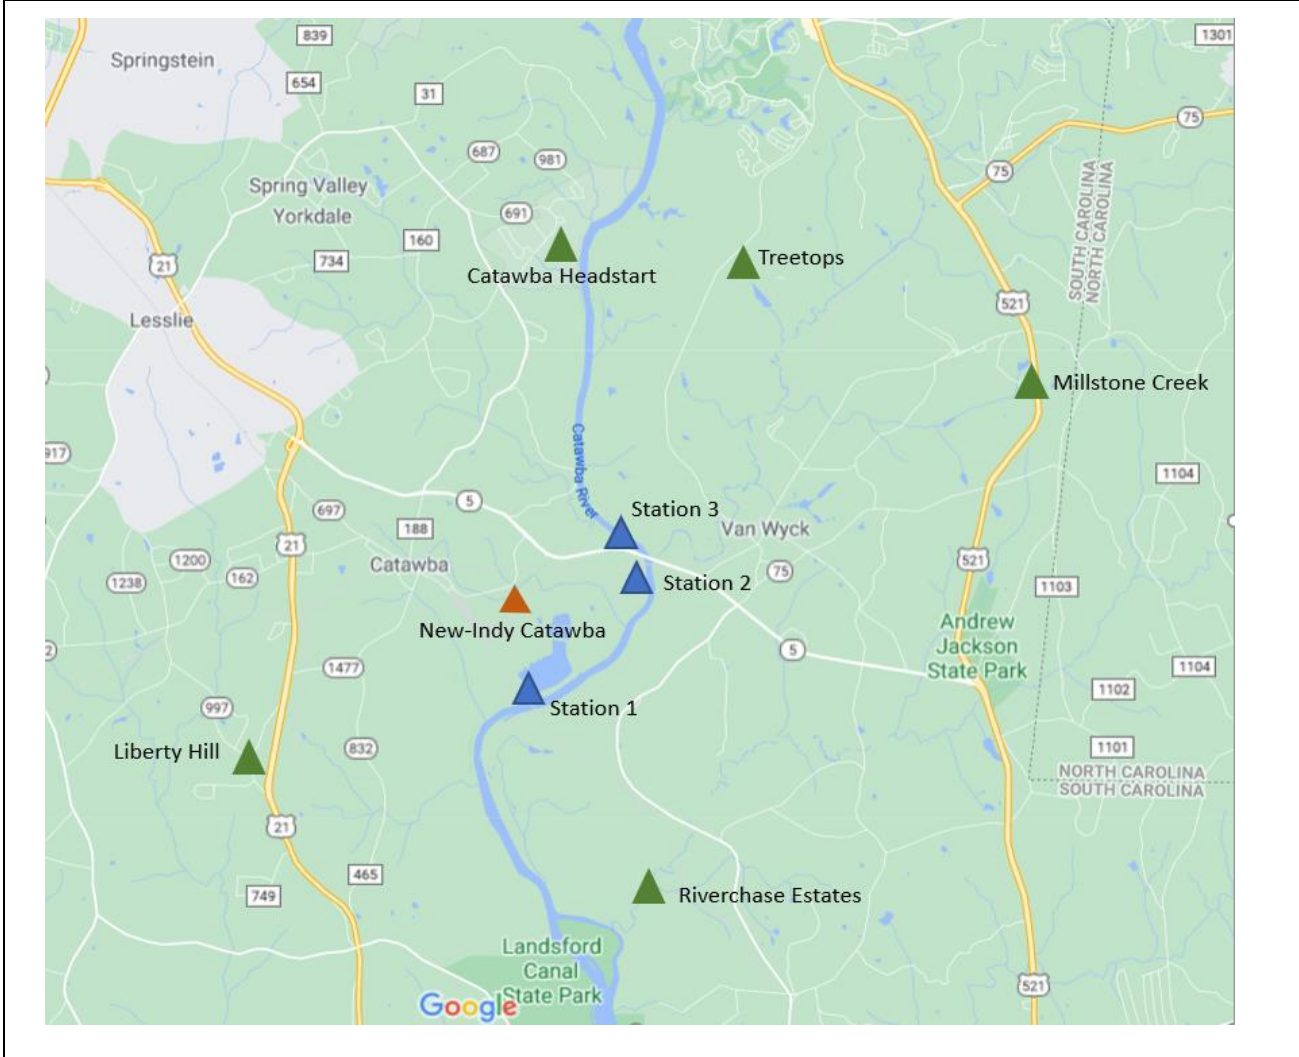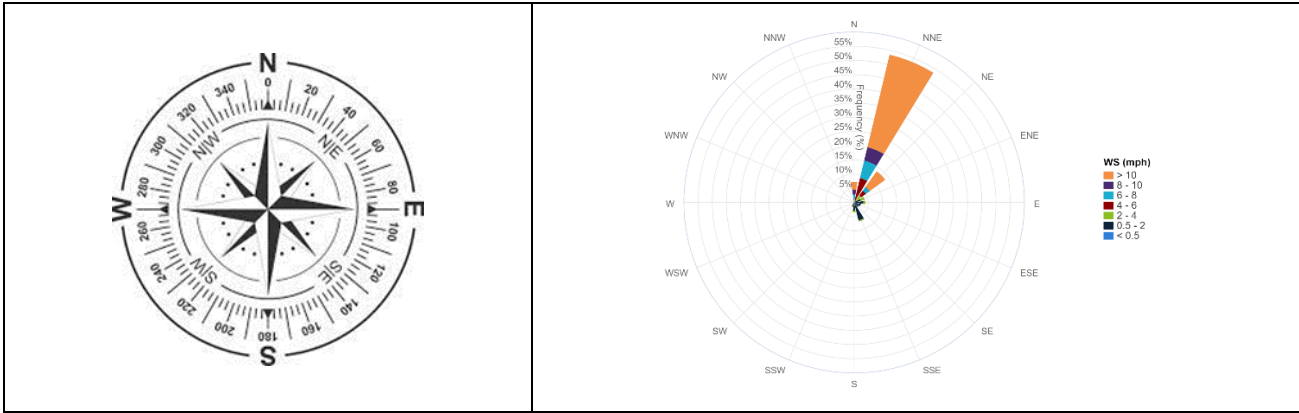


Period H₂S Monitoring Hydrogen Sulfide Offsite Monitors

Below are graphs for offsite locations where hydrogen sulfide (H₂S) was detected during the current reporting period.

The five stand-alone H₂S monitoring stations correlate with five previous EPA's Viper monitoring system which includes areas to the north-northeast and south-southwest of the New-Indy Catawba Mill.


Winds were predominantly coming from the north-northeast direction throughout the day at 1 to 19 mph.

See wind rose diagram with aerial map figure for full wind data during this reporting period.

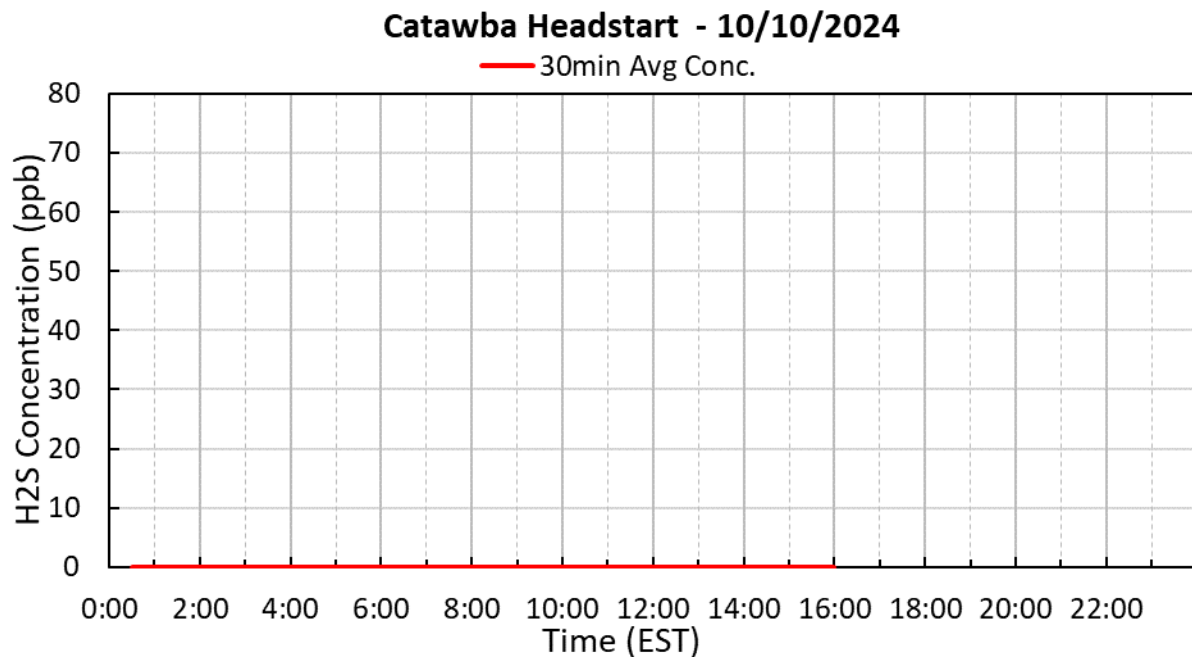


Treetops - 10/10/2024

— 30min Avg Conc.

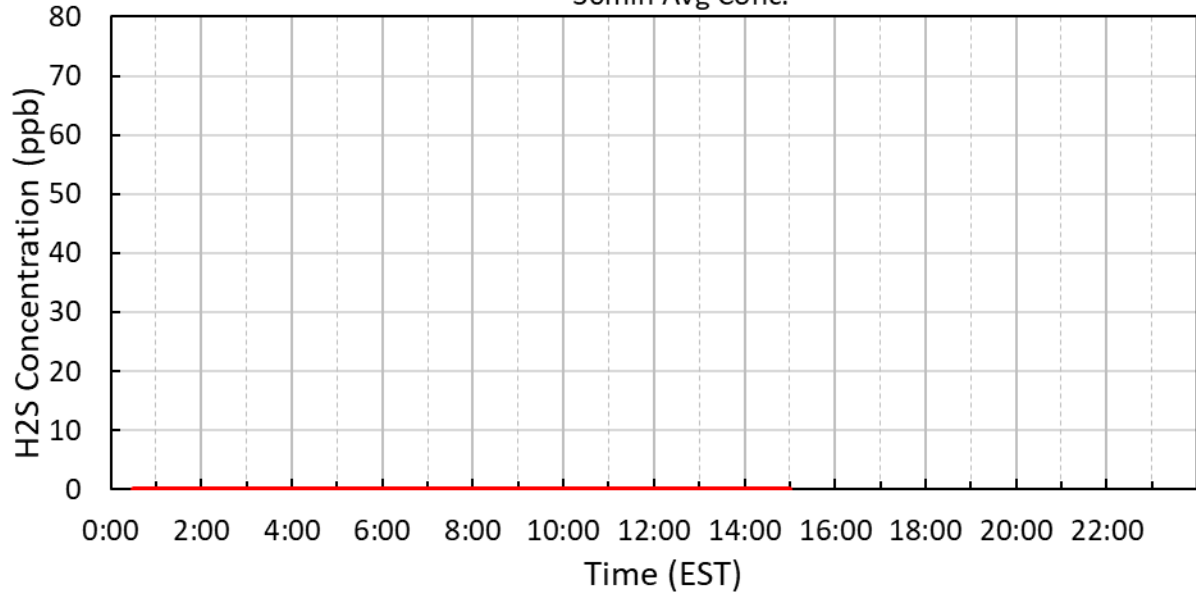


Liberty Hill - 10/10/2024

— 30min Avg Conc.

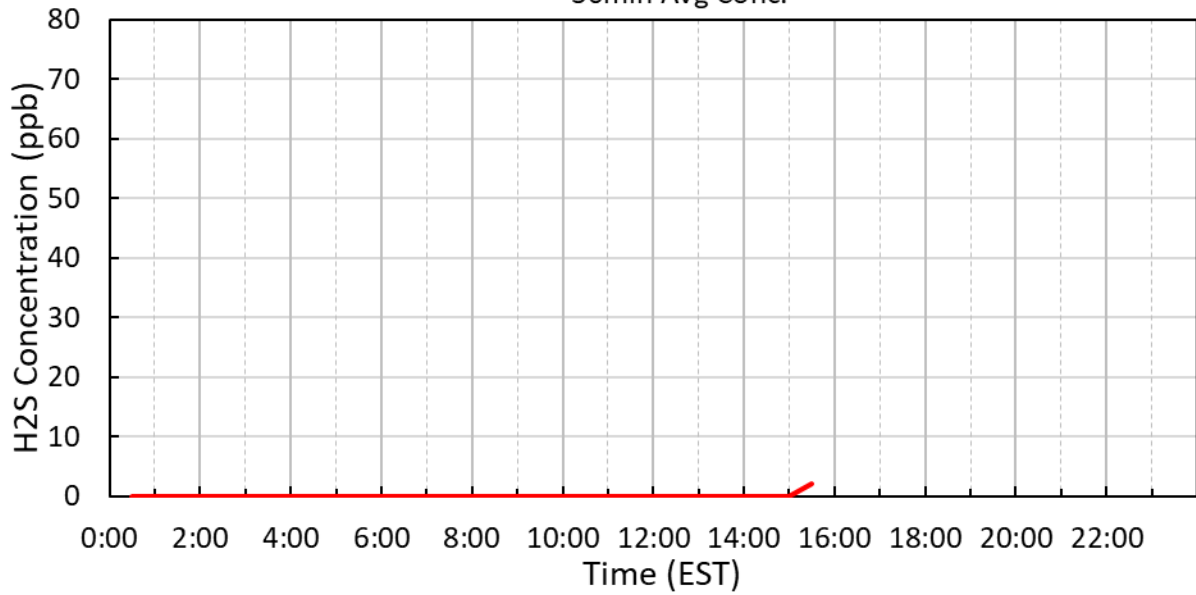


Riverchase - 10/10/2024

— 30min Avg Conc.

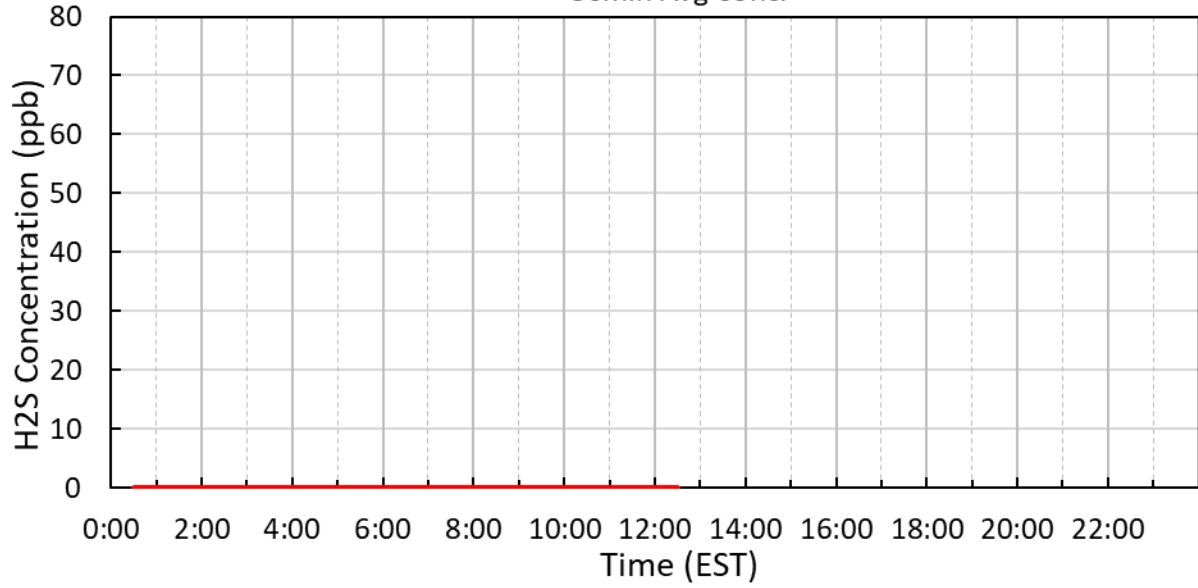

Millstone Creek - 10/10/2024

— 30min Avg Conc.

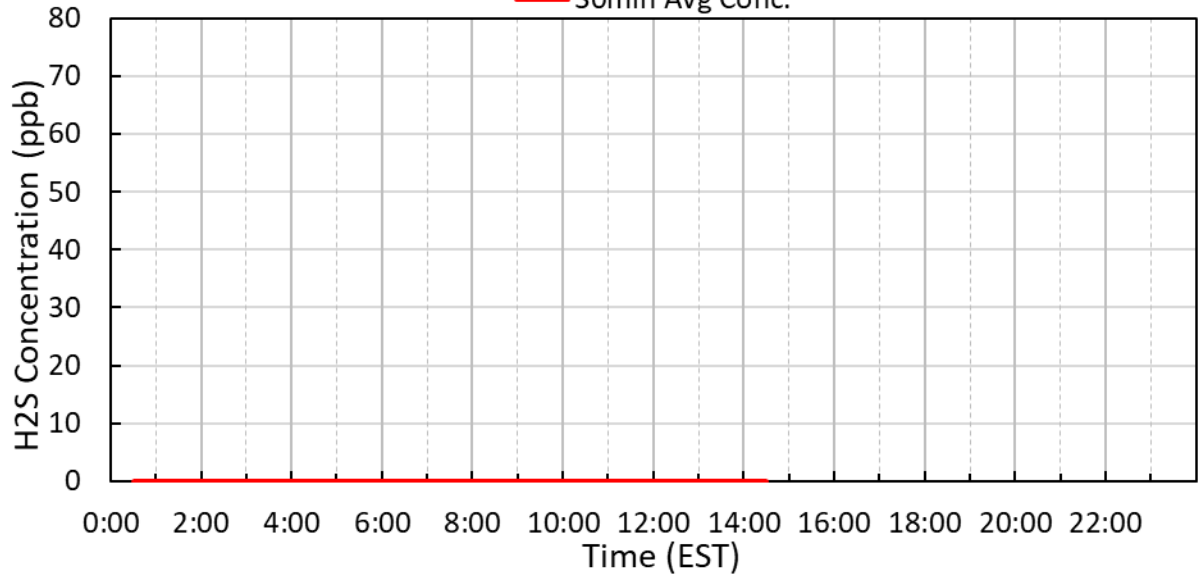



Period H₂S Monitoring Hydrogen Sulfide Onsite Monitors

Below are graphs for onsite locations during the current reporting period.


Depending on wind direction, the H₂S measured at the onsite fence line locations may not exit the mill property at reported concentrations. Wind directions from offsite locations, blowing onto mill property, will disperse ambient concentrations to lower levels prior to exiting the plant site.

Winds were predominantly coming from the north-northeast direction throughout the day at 1 to 19 mph.

See wind rose diagram with aerial map figure for full wind data during this reporting period.

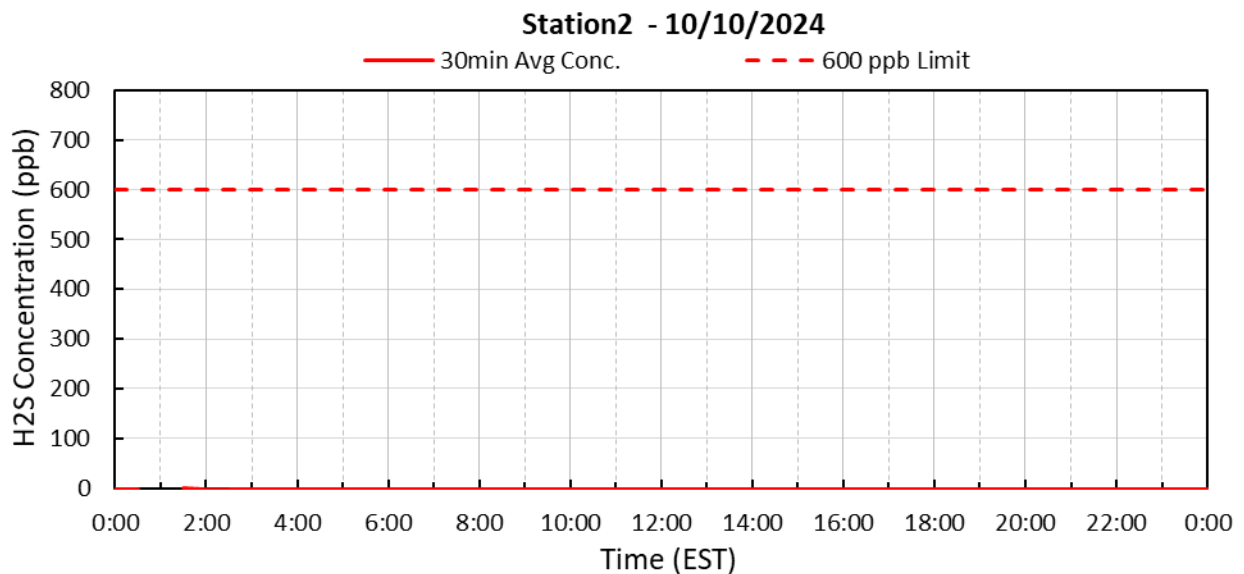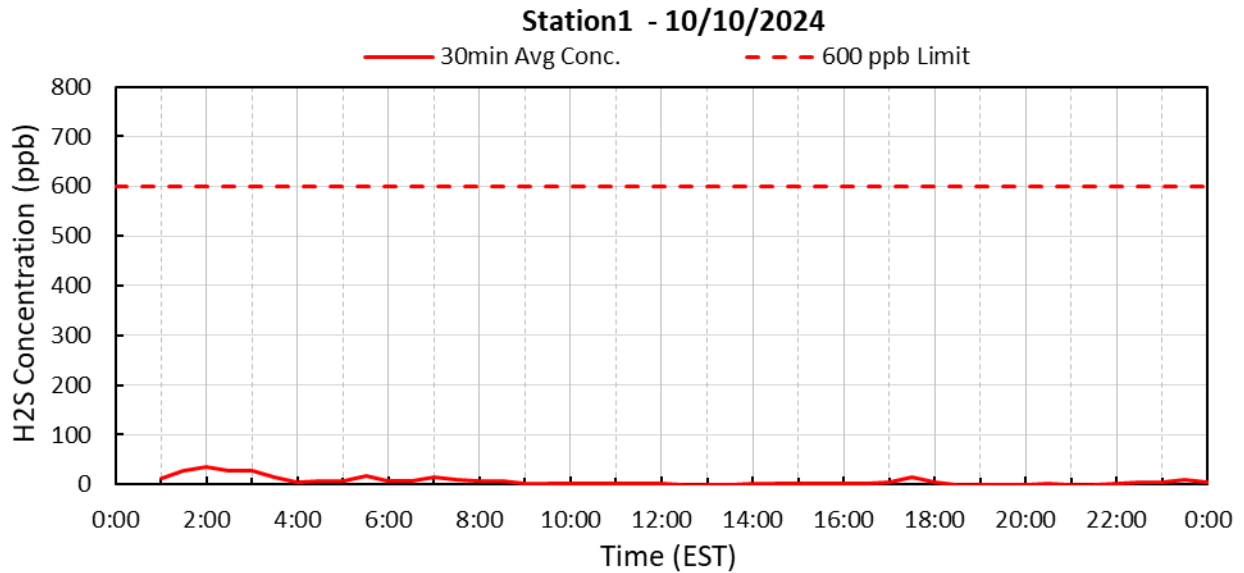

Station3 - 10/10/2024

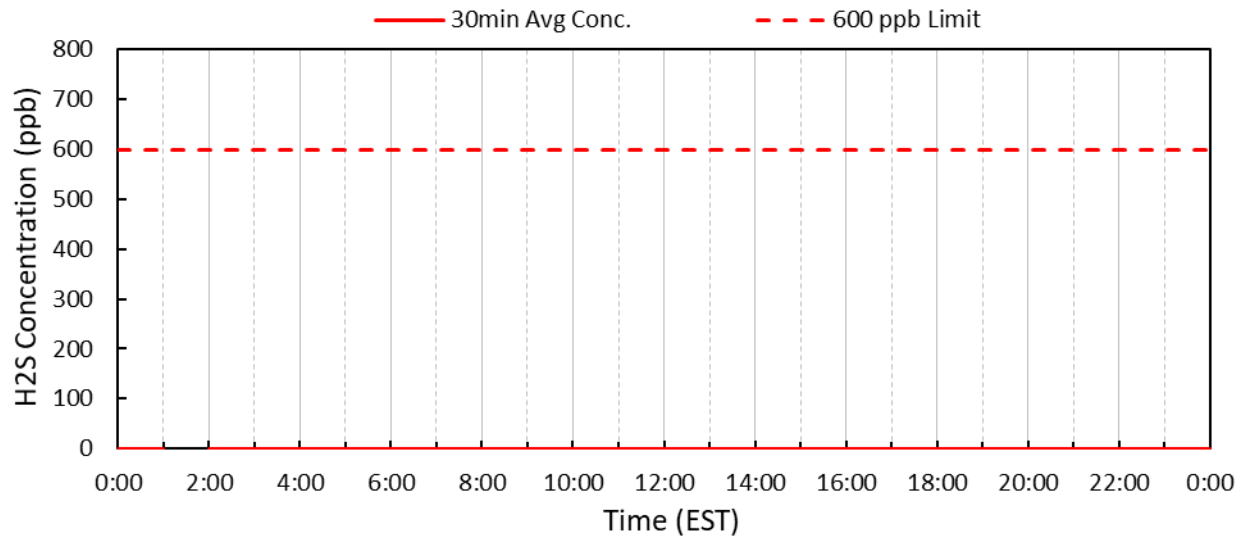

Submitted Fenceline H₂S and Met 30-minute Data

30-Minute Avgs	Station 1			Station 2			Station 3		
	H2S	Met		H2S	Met		H2S	Met	
	30min Avg H2S Conc.	30min Avg WS	30min Avg WD	30min Avg H2S Conc.	30min Avg WS	30min Avg WD	30min Avg H2S Conc.	30min Avg WS	30min Avg WD
Date / Time	ppb	mph	degrees	ppb	mph	degrees	ppb	mph	degrees
10/10/2024 0:30	AX	1.3	106	0.2	0.5	18	0.2	0.3	270
10/10/2024 1:00	11.4	2.9	16	AX	0.8	13	0.2	0.5	306
10/10/2024 1:30	28.5	4.9	18	0.4	0.6	31	AX	1.0	344
10/10/2024 2:00	36.6	6.2	18	0.2	0.4	27	0.2	0.8	15
10/10/2024 2:30	28.5	7.4	13	0.2	0.5	56	0.2	2.3	359
10/10/2024 3:00	28.4	8.4	13	0.2	0.5	102	0.2	2.5	357
10/10/2024 3:30	15.9	6.3	26	0.2	0.2	57	0.2	1.4	17
10/10/2024 4:00	4.0	5.3	30	0.2	0.3	82	0.2	1.3	15
10/10/2024 4:30	8.4	5.4	27	0.2	0.2	59	0.2	1.1	15
10/10/2024 5:00	6.6	5.6	31	0.2	0.5	79	0.2	1.8	10
10/10/2024 5:30	17.9	7.1	23	0.2	0.8	120	0.2	2.3	16
10/10/2024 6:00	8.1	11.1	25	0.2	1.0	98	0.2	2.8	18
10/10/2024 6:30	6.8	12.6	24	0.2	1.1	83	0.2	3.0	18
10/10/2024 7:00	14.8	14.7	18	0.2	2.0	57	0.2	3.6	17
10/10/2024 7:30	10.7	15.4	20	0.2	2.0	52	0.2	3.8	18
10/10/2024 8:00	6.6	17.7	25	0.2	2.6	52	0.2	4.6	32
10/10/2024 8:30	6.3	19.0	28	0.2	2.8	45	0.2	5.3	26
10/10/2024 9:00	1.7	18.0	32	0.2	3.0	48	0.2	5.2	32
10/10/2024 9:30	1.3	16.8	29	0.2	2.8	48	0.2	5.0	37
10/10/2024 10:00	1.2	18.3	29	0.2	3.0	51	0.2	4.7	30
10/10/2024 10:30	1.6	17.4	29	0.2	3.6	40	0.2	5.1	27
10/10/2024 11:00	1.7	18.0	24	0.2	3.1	29	0.2	5.9	32
10/10/2024 11:30	1.3	18.0	24	0.2	4.0	29	0.2	5.7	31
10/10/2024 12:00	1.7	17.7	24	0.2	5.1	22	0.2	5.4	33
10/10/2024 12:30	0.8	17.1	33	0.2	3.7	42	0.2	5.4	42
10/10/2024 13:00	0.7	15.6	30	0.2	3.5	46	0.2	5.2	37
10/10/2024 13:30	0.5	15.5	34	0.2	3.5	44	0.2	4.9	42
10/10/2024 14:00	1.5	12.8	32	0.2	3.6	36	0.2	4.2	33
10/10/2024 14:30	1.0	12.0	25	0.2	2.5	43	0.2	3.4	22
10/10/2024 15:00	1.3	11.4	18	0.2	4.0	31	0.2	3.6	30
10/10/2024 15:30	2.7	12.1	18	0.2	3.5	20	0.2	4.2	30
10/10/2024 16:00	1.9	12.0	23	0.2	2.7	37	0.2	3.7	16
10/10/2024 16:30	2.3	11.4	10	0.2	2.4	13	0.2	3.6	9
10/10/2024 17:00	5.0	8.8	13	0.2	1.5	20	0.2	2.5	11
10/10/2024 17:30	13.8	6.5	11	0.2	0.6	48	0.2	1.2	359
10/10/2024 18:00	5.8	4.0	50	0.2	0.4	67	0.2	0.3	54
10/10/2024 18:30	0.2	1.5	172	0.2	0.7	57	0.2	0.3	286
10/10/2024 19:00	0.2	2.0	121	0.2	0.7	41	0.2	0.4	334
10/10/2024 19:30	0.2	1.0	153	0.2	0.5	33	0.2	0.3	321
10/10/2024 20:00	0.4	1.3	169	0.2	0.5	27	0.2	0.4	255
10/10/2024 20:30	1.0	1.8	186	0.2	0.9	348	0.2	0.3	251
10/10/2024 21:00	0.7	1.6	182	0.2	0.3	356	0.2	0.3	283
10/10/2024 21:30	0.5	1.1	162	0.2	0.4	346	0.2	0.2	244
10/10/2024 22:00	1.0	0.6	115	0.2	0.6	26	0.2	0.4	295
10/10/2024 22:30	3.6	1.1	101	0.2	0.3	45	0.2	0.3	230
10/10/2024 23:00	4.9	1.4	86	0.2	0.6	46	0.2	0.3	327
10/10/2024 23:30	10.0	2.1	73	0.2	0.6	45	0.2	0.2	166
10/11/2024 0:00	5.5	1.8	56	0.2	0.8	56	0.2	0.2	261

AQS Null Data Codes	
Qualifier Code	Item Description
AB	TECHNICIAN UNAVAILABLE
AC	CONSTRUCTION/REPAIRS IN AREA
AD	SHELTER STORM DAMAGE
AE	SHELTER TEMPERATURE OUTSIDE LIMITS
AI	INSUFFICIENT DATA (CAN'T CALCULATE)
AM	MISCELLANEOUS VOID
AN	MACHINE MALFUNCTION
AO	BAD WEATHER
AP	VANDALISM
AS	POOR QUALITY ASSURANCE RESULTS
AT	CALIBRATION
AU	MONITORING WAIVED
AV	POWER FAILURE (POWR)
AW	WILDLIFE DAMAGE
AX	PRECISION CHECK (PREC)
AY	Q C CONTROL POINTS (ZERO/SPAN)
AZ	Q C AUDIT (AUDT)
BA	MAINTENANCE/ROUTINE REPAIRS
BB	UNABLE TO REACH SITE
BC	MULTI-POINT CALIBRATION
BD	AUTO CALIBRATION
BE	BUILDING/SITE REPAIR
BF	PRECISION/ZERO/SPAN
BJ	OPERATOR ERROR
BK	SITE COMPUTER/DATA LOGGER DOWN
EC	EXCEED CRITICAL CRITERIA