

Air Monitoring Summary Tables

The table below summarizes monitoring data collected using the H₂S analyzers deployed at the onsite stations.

All times in Eastern Standard Time (EST).

From: 12/23/25 12:00 am

To: 12/23/25

11:59 pm

Onsite Fenceline Monitors

Instrument	Analyte	30-min AEGL Reached?	Concentration Range Detected ^a	24-hr Average ^a	7-day Average	30-min AEGL
Station 1						
TAPI Analyzer	H ₂ S	No	1 – 3 ppb	0.69 ppb ^b	1.13 ppb	600 ppb
Station 2						
TAPI Analyzer	H ₂ S	No	0 – 2 ppb	0.67 ppb	0.52 ppb	600 ppb
Station 3						
TAPI Analyzer	H ₂ S	No	0 – 5 ppb	1.68 ppb	0.88 ppb	600 ppb

^a Based on 30-minute averages.

^b The 24-hour H₂S average at Station 1 is not represented by the full 24-hour sampling period; a total of 2 30-minute averages are missing due to a manual QC check performed at this location.

Notes:

ATSDR MRL Agency for Toxic Substances and Disease Registry Minimal Risk Level (MRL)

AEGL EPA Acute Exposure Guidelines Levels

H₂S Hydrogen Sulfide

TAPI Teledyne API H₂S Analyzer


hr Hour


min Minute

ppb Parts per billion

MRL Limit Limit defined as a 14-day average value

Station 1 Wind Rose – Shows the direction the wind is coming from, the monitoring station being at the center of the rose.

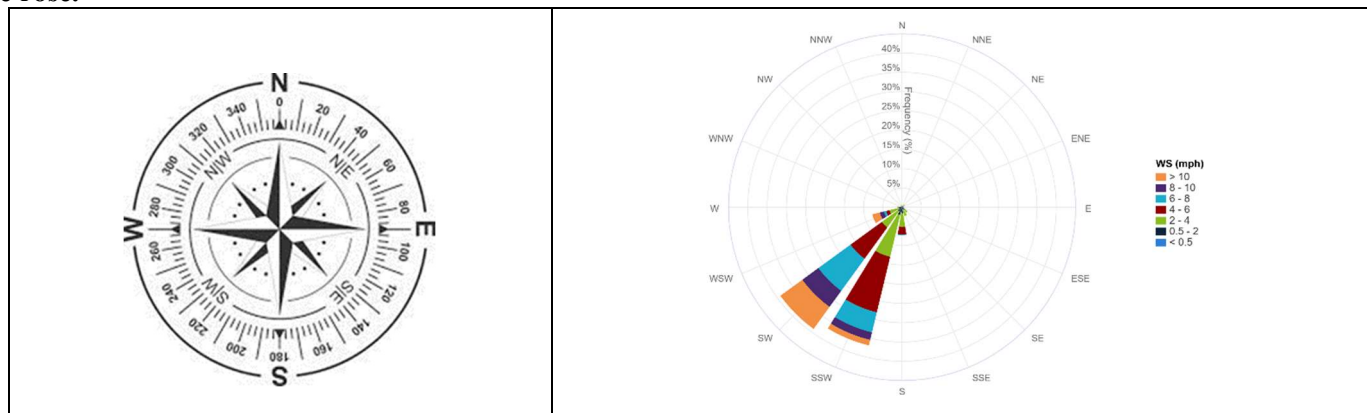

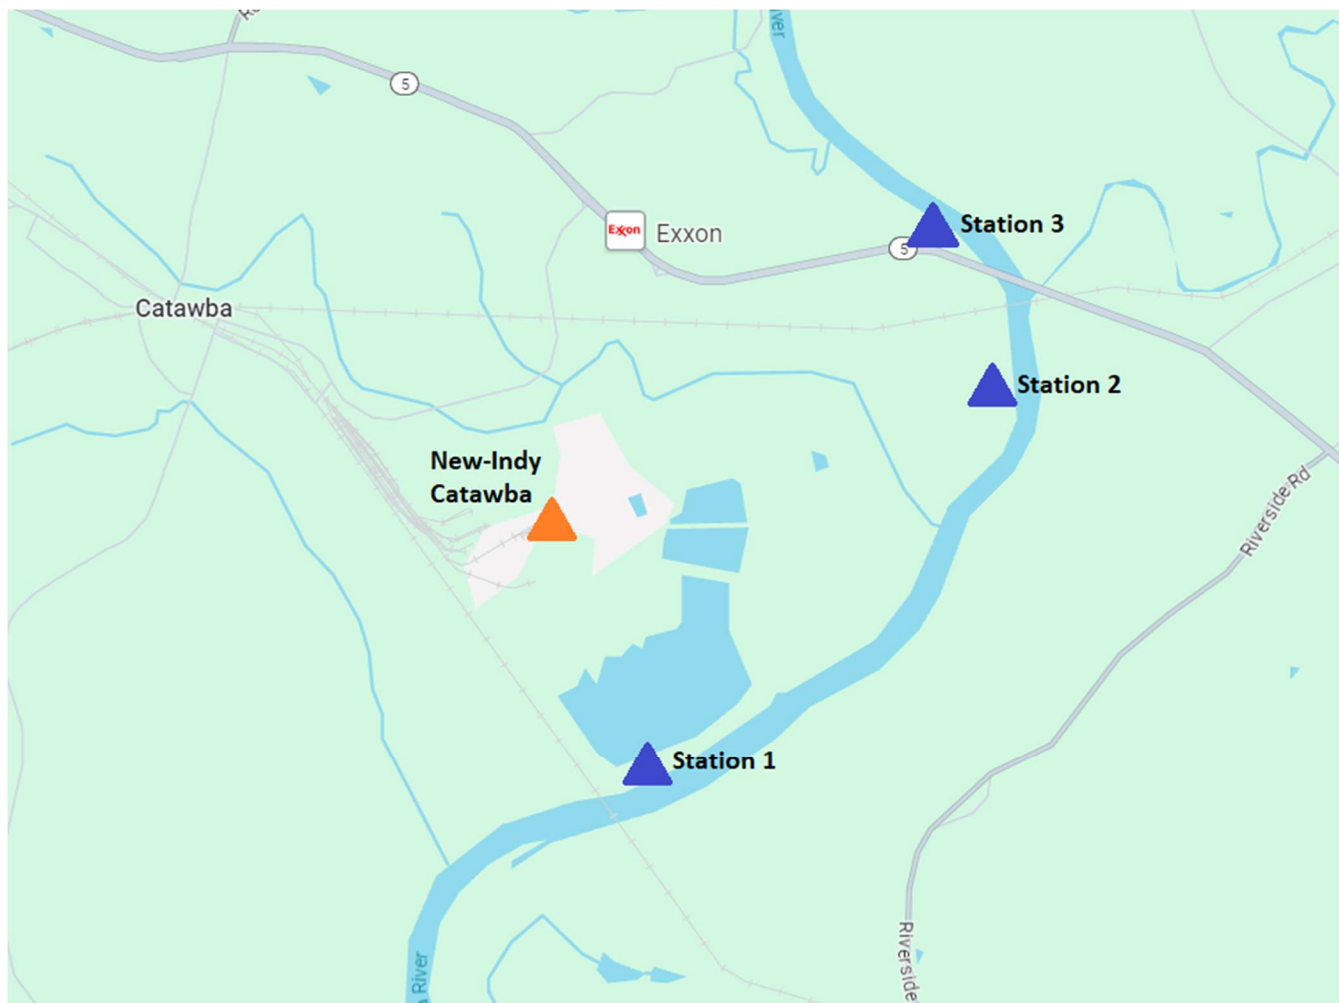

Legend



Onsite Fixed Monitoring Locations



New-Indy Catawba



Period H₂S Monitoring Hydrogen Sulfide Onsite Monitors

Below are graphs for onsite locations during the current reporting period.


Depending on wind direction, the H₂S measured at the onsite fence line locations may not exit the mill property at reported concentrations. Wind directions from offsite locations, blowing onto mill property, will disperse ambient concentrations to lower levels prior to exiting the plant site.

Winds were predominantly coming from the southwest and south-southwest direction throughout the day at 1 to 14 mph.

See wind rose diagram with an aerial map figure for full wind data during this reporting period.

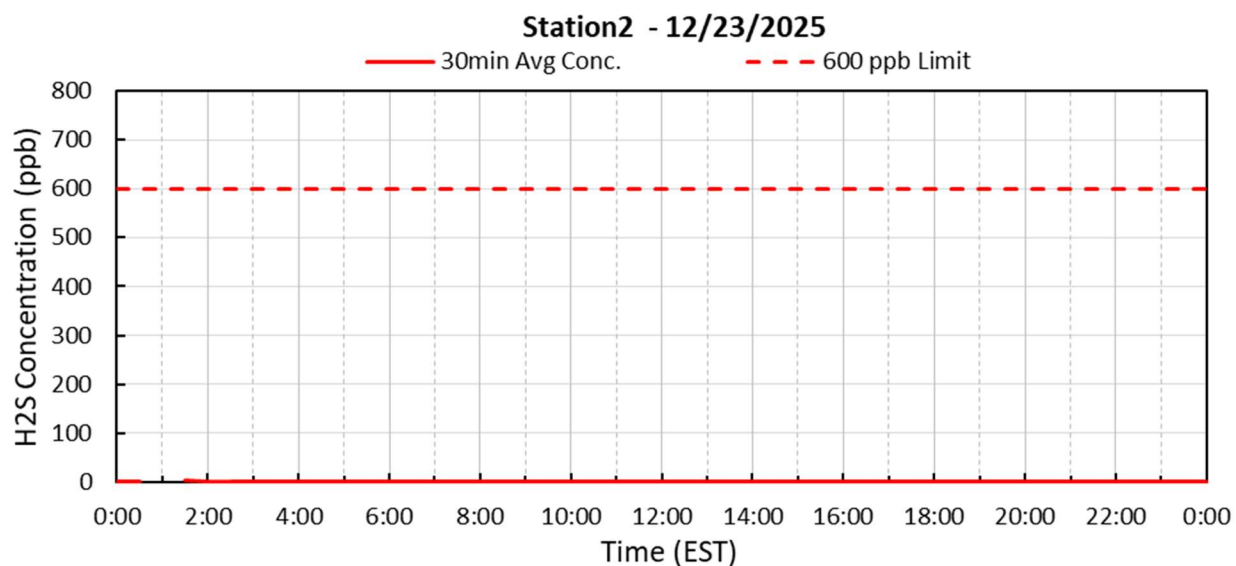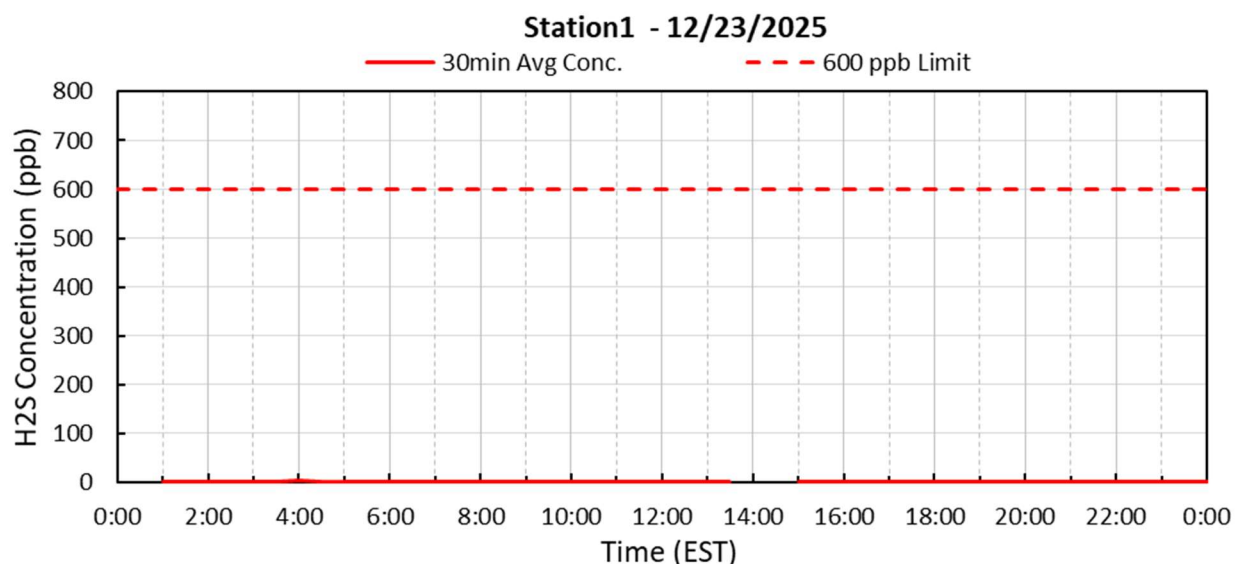

Station3 - 12/23/2025

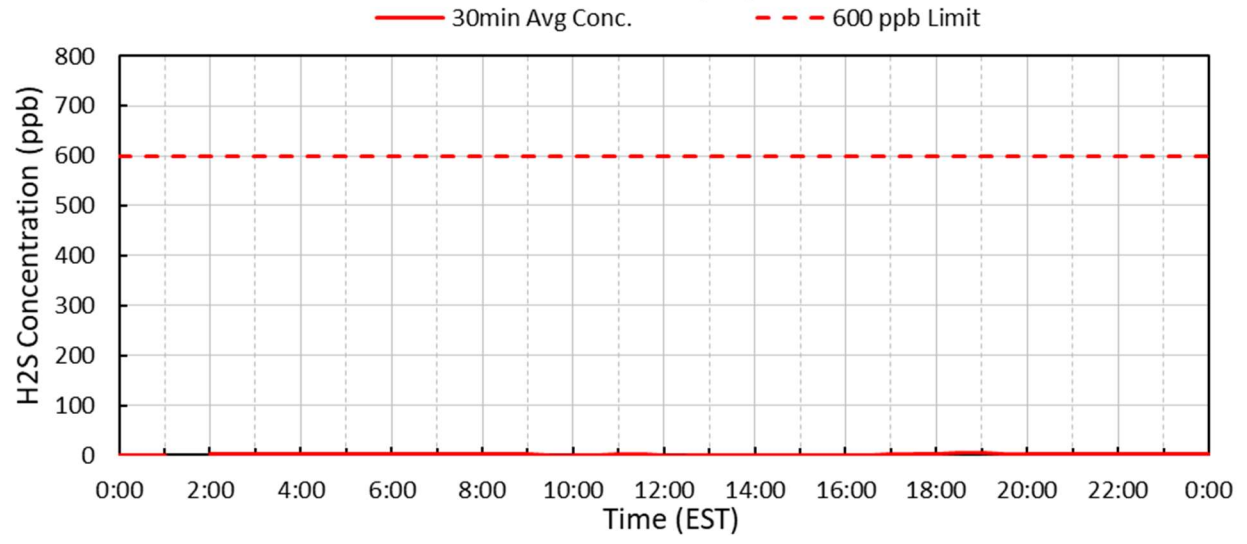

Submitted Fenceline H₂S and Met 30-minute Data

30-Minute Avgs	Station 1			Station 2			Station 3		
	H2S	Met		H2S	Met		H2S	Met	
12/23/2025	30min Avg H2S Conc.	30min Avg WS	30min Avg WD	30min Avg H2S Conc.	30min Avg WS	30min Avg WD	30min Avg H2S Conc.	30min Avg WS	30min Avg WD
Date / Time	ppb	mph	degrees	ppb	mph	degrees	ppb	mph	degrees
12/23/2025 0:30	AX	2.4	214	0.2	0.3	333	0.2	0.4	336
12/23/2025 1:00	0.8	2.6	195	AX	0.8	313	0.2	1.0	197
12/23/2025 1:30	0.6	2.3	207	2.2	0.5	353	AX	0.7	359
12/23/2025 2:00	0.6	1.5	175	0.9	0.7	42	1.1	0.5	93
12/23/2025 2:30	0.6	2.1	225	0.6	0.7	249	1.9	0.7	250
12/23/2025 3:00	0.5	1.8	220	0.2	1.0	357	2.0	1.0	346
12/23/2025 3:30	0.5	1.2	58	1.4	1.2	45	1.8	1.0	276
12/23/2025 4:00	3.3	1.7	125	1.0	0.5	92	1.6	0.6	128
12/23/2025 4:30	1.6	2.3	196	1.1	0.7	334	1.5	0.6	234
12/23/2025 5:00	0.6	2.2	207	1.1	0.3	264	1.6	0.7	237
12/23/2025 5:30	0.5	2.2	209	1.3	1.3	279	2.0	0.5	236
12/23/2025 6:00	0.5	3.8	198	0.8	0.9	202	2.6	1.0	176
12/23/2025 6:30	0.6	3.1	197	0.2	1.7	227	1.7	1.0	260
12/23/2025 7:00	0.6	4.1	207	0.2	0.7	273	2.4	0.4	96
12/23/2025 7:30	0.6	4.9	199	0.2	2.0	176	1.1	1.4	168
12/23/2025 8:00	0.6	4.8	212	0.2	2.9	215	1.4	0.9	172
12/23/2025 8:30	0.6	6.8	206	0.2	4.4	213	2.6	2.2	179
12/23/2025 9:00	0.6	7.8	213	1.0	5.1	231	2.9	2.0	208
12/23/2025 9:30	0.6	5.3	225	1.9	4.1	231	0.9	1.4	251
12/23/2025 10:00	0.7	6.2	213	0.8	4.7	226	0.8	3.2	217
12/23/2025 10:30	0.6	6.6	219	1.0	5.9	232	0.8	2.5	235
12/23/2025 11:00	0.6	7.9	212	0.2	5.4	230	2.1	2.6	214
12/23/2025 11:30	0.6	7.4	220	0.6	7.0	241	1.1	3.5	235
12/23/2025 12:00	0.6	8.7	227	1.0	8.7	246	0.4	4.4	236
12/23/2025 12:30	0.6	11.9	225	0.9	10.5	241	0.4	5.2	242
12/23/2025 13:00	0.6	14.1	234	0.9	11.8	248	0.2	4.5	247
12/23/2025 13:30	0.6	13.6	233	0.6	11.7	245	0.4	4.8	238
12/23/2025 14:00	AX	9.2	233	0.7	10.1	246	0.2	5.0	227
12/23/2025 14:30	AX	9.4	218	0.8	8.4	241	0.7	4.1	233
12/23/2025 15:00	0.7	9.4	222	0.5	7.6	242	0.5	4.1	234
12/23/2025 15:30	0.6	8.1	233	0.7	6.8	240	0.2	3.0	241
12/23/2025 16:00	0.6	7.7	221	0.4	6.4	236	0.2	3.2	231
12/23/2025 16:30	0.6	7.6	217	0.2	4.9	229	0.7	2.6	229
12/23/2025 17:00	0.6	6.5	214	0.2	5.2	234	1.2	2.7	233
12/23/2025 17:30	0.6	4.6	207	0.2	2.9	224	1.3	1.7	227
12/23/2025 18:00	0.6	3.8	198	0.2	1.4	196	3.6	1.4	182
12/23/2025 18:30	0.6	5.1	205	0.2	1.7	222	5.1	1.6	199
12/23/2025 19:00	0.6	6.2	215	0.6	2.3	225	5.4	2.5	210
12/23/2025 19:30	0.6	6.4	218	0.6	3.6	232	2.8	3.1	224
12/23/2025 20:00	0.6	6.2	220	1.8	3.6	231	1.6	2.3	222
12/23/2025 20:30	0.6	6.1	220	0.2	3.3	227	2.5	2.3	204
12/23/2025 21:00	0.7	5.3	216	0.2	3.4	222	3.1	2.9	210
12/23/2025 21:30	0.6	4.7	220	0.2	3.3	219	1.9	2.6	228
12/23/2025 22:00	0.6	3.7	195	0.2	3.3	215	2.0	2.2	211
12/23/2025 22:30	0.6	3.9	197	0.2	3.0	217	3.4	1.9	192
12/23/2025 23:00	0.7	4.7	207	0.5	2.6	237	2.2	1.3	245
12/23/2025 23:30	0.7	4.6	214	1.1	0.9	279	2.1	0.5	346
12/24/2025 0:00	0.7	2.6	301	0.9	0.9	61	2.6	0.6	58

AQS Null Data Codes	
Qualifier Code	Item Description
AB	TECHNICIAN UNAVAILABLE
AC	CONSTRUCTION/REPAIRS IN AREA
AD	SHELTER STORM DAMAGE
AE	SHELTER TEMPERATURE OUTSIDE LIMITS
AI	INSUFFICIENT DATA (CAN'T CALCULATE)
AM	MISCELLANEOUS VOID
AN	MACHINE MALFUNCTION
AO	BAD WEATHER
AP	VANDALISM
AS	POOR QUALITY ASSURANCE RESULTS
AT	CALIBRATION
AU	MONITORING WAIVED
AV	POWER FAILURE (POWR)
AW	WILDLIFE DAMAGE
AX	PRECISION CHECK (PREC)
AY	QC CONTROL POINTS (ZERO/SPAN)
BA	MAINTENANCE/ROUTINE REPAIRS
BB	UNABLE TO REACH SITE
BC	MULTI-POINT CALIBRATION
BD	AUTO CALIBRATION
BE	BUILDING/SITE REPAIR
BF	PRECISION/ZERO/SPAN
BJ	OPERATOR ERROR
BK	SITE COMPUTER/DATA LOGGER DOWN
BL	QC AUDIT (AUDT)
EC	EXCEED CRITICAL CRITERIA